

TECHNICAL DATA SHEET

Physical Properties		Operating Conditions	
Colour	Brown to Black	pH Range	5.8 – 8.6
Bulk Density	91.0 lbs/ft ³ 1.46 gr/m ³ 1.46 tonne/m ³	Maximum Water Temperature	113° F (45° C)
Specific Gravity	2.69	Minimum Bed Depth	24 Inches (600mm)
Effective Size	0.3 – 0.6mm	Freeboard	40% minimum
Uniformity Coefficient	1.4	Service Flow Rate	5 – 30 m ³ /m ² per hr
Mesh Size	20 - 40	Backwash Flow Rate	25 – 40 m ³ /m ² per hr
Annual Attrition	1% - 5%	Backwash Expansion	20% - 50%

Infusion Technology: Powerful oxidizing agents are chemically infused to the microporous sub-structure of the matrix material. Infusion Technology increases the catalytic surface and gives DMI-65 the highest oxidation rate and load capacity of any other catalytic media.

Infusion Technology allows for very small attrition loss and displays no decaying effect or loss of catalysis for up to 5 – 10 years of continuous performance.

DMI-65 protects and pre-treats all other water treatment systems from iron and manganese bio-fouling, effectively longer filter run times, and with the benefit of reduced oxidant demand and because DMI-65 Infusion Technology requires no chemical regeneration,

DMI -65 is the lowest cost of whole life iron and manganese removal media.

Optimum Range of Water Chemistry for up to 10 Years Continuous Use	
pH	5.8 – 8.6
Turbidity	<2 NTU
Iron (Fe)	<15 ppm
Manganese (Mn)	<3 ppm
Calcium (CaCO ₃)	<250 ppm
Salt (NaCl)	<1000 ppm
TDS	<2000 ppm
Ammonia (NH ₃)	<1 ppm
Silica (SiO ₂)	<1 ppm

DMI-65 CERTIFICATION:

Tested and Certified Under Industry Standards: NSF / ANSI 61 by the Water Quality Association of USA Gold Seal Program
For safety and health effects for drinking water components.



Authorized by the Drinking Water Inspectorate safe to use according to:
Regulation 31(4)(a) of the water supply (Water Quality) regulations 2010 for UK, England and Wales

[Engineering \(Hydraulic\) Data](#)

Bed Depth and Water Velocity

Filter media depth needed increases with the decrease in the amount of residual iron and manganese allowed in the filtered water. Maximum bed depth could be just over 1 meter and relates also to the flow capacity of the system and effective height of available filters.

Water velocity through the filter should be selected in accordance with the usage of the filtered water, size of water treatment plant, water quality and other factors.

For large drinking water treatment plants the depth of the bed should be selected towards the maximum and the water velocity around 5 m³/m²/hour in any case not more than 10 m³/m² /hour. This maximizes performance in removing iron and manganese, reduces the frequency of backwashing, reduces power consumption because average pressure drop is lower, and could provide redundancy in case one of the filters is out of order and higher flow rate has to be put through the remaining filters.


The upper limit of velocity, up to 30 m³/m² /hour should be used for small bed depth and larger allowed amount of residual iron and manganese in the filtered water.

Pressure drop

The pressure drop is related to the velocity of the water through the cross sectional area of the filter because its usefulness and the simplicity of relating the data to flow rate. The flow rate "Q" in cubic meters per hour can be calculated by multiplying the velocity "v" in meters per hour by the filter area "A" in square meters.

$$Q = v \times A$$

The pressure drop for an initial clean filter depends on the depth of the filter media bed and the water velocity. The chart below shows the pressure drop for 1 meter (3.3. foot) bed depth. For other bed depth the pressure drop can be considered linearly dependent on the bed depth. Therefore, to calculate the pressure drop for 0.6m bed depth you multiply the value for pressure drop found in the chart by 0.6.

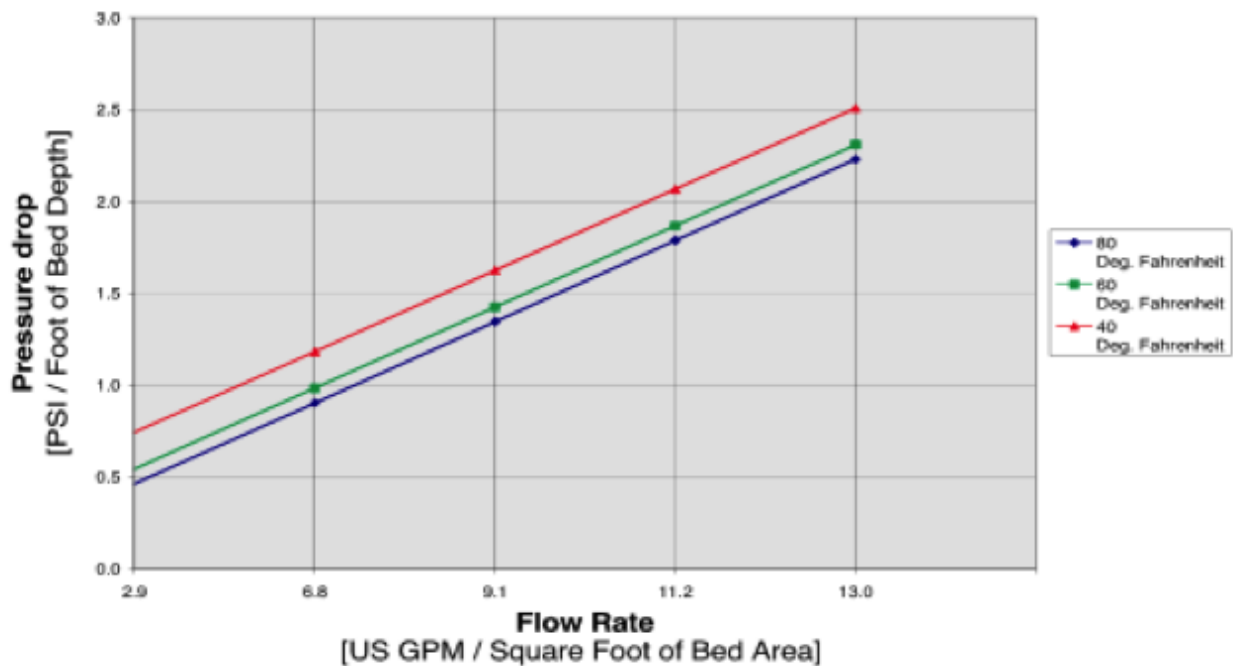


Backwashing Pressure Drop

The total pressure drop through the filter before backwashing is recommended to be 50kpa and up to a maximum 100 kPa. The granules of DMI-65 filter media are micro - porous. The larger the pressure drop, the larger compaction forces are applied to the filter media. The interaction between filter media particles during alternated compaction under normal service and expansion of the bed during backwashing leads in time to deterioration of granules. Backwashing the filter when the pressure drop has increased by 50 kPa from the initial clean filter pressure drop is a good reference. Higher or lower values could be set depending on the application and how long the filter media has to last before changing it. Note that the filter media would not significantly lose the effectiveness in removing the iron and manganese but the loss in head pressure will increase as a clean media bed loads to capacity.

The water velocity for backwashing the filter is recommended to be limited to 40 – 50m³/m²/hour m/hr. This is the same as recommended for ordinary sand filtration. Although it is possible to use not filtered water for backwashing in general this is not a good idea unless the water is relatively clean and the system is set up with a rinse operating mode in addition to filtration and backwashing. At low backwashing velocity longer backwashing time is needed. In general backwashing velocity should be twice the filtration velocity.

Backwashing time should be determined by using a site glass on the discharge backwash line or in some other way observe when the backwash water discharged is satisfactorily clean. Backwashing time could vary from a few minutes to 15 minutes.

A rinse mode can follow backwashing to remove the contaminant solids that would exit the filter before the filter bed is compacted back and operates normally. This mode is not necessary to be implemented in all water treatment systems. Rinse time should be around 30 seconds for small bed depth and 1 minute or a little more for upper limit of bed depth. The required time could be found by checking the presence of contamination in the filtered water when restarting normal filtration operation.

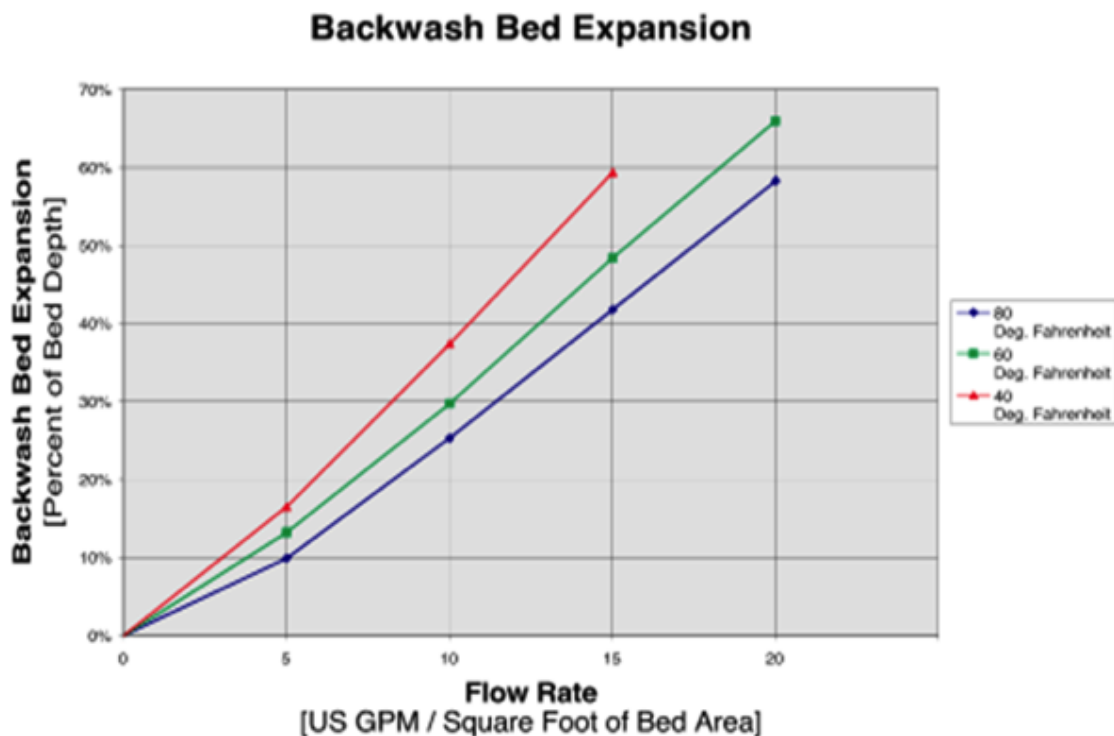

Suggested Operating Conditions

Linear Velocity and Iron and Manganese Concentrations.

The correct design based on Linear Velocity (LV) versus Iron (Fe) and Manganese (Mn) values is a little more complex to offer an explanation in formula or scale. Successful data provided to DMI-65 users is based on over 15 years of successful installations in over 40 countries worldwide.

For iron removal, flux, or linear velocity is allot higher than manganese. The reaction of iron and chlorine is almost instantaneous and is easily removed through silica sand alone. For example it possible to remove 20ppm of iron down to 0.5ppm. This can be done at a fairly neutral pH range of 7 – 7.5. Removing iron with normal silica sand alone can be done at Linear Velocity (LV) range of about LV8 – 9 m3/m2/hour.

Removing the remaining 0.5ppm of iron to below 0.3ppm or to an undetectable 0.001ppm is much more difficult than removing 20ppm down to 0.5ppm. This is where the DMI-65 advanced oxidation “booster” qualities come into play. DMI-65 has been coined a high performance “polisher” for removing the very smallest traces of iron and simultaneously manganese in the same filter bed.

The extra oxidating quality of the DMI-65 catalytic surfaces allow iron to be effectively removed in pH range of 5.8 – 8.6, however best results again are at basic pH 7 – 7.5. In comparison to silica sand the DMI-65 could filter iron up to LV 16 – 18m3/m2/hour rather than 8 – 9m3/m2/hour.

Manganese removal is far more difficult to remove than iron removal. DMI-65 Infusion Technology is tailor made to maximise the ease of manganese removal and especially simultaneously with iron removal (In the same filter bed). Manganese requires far greater detention time and is very pH dependant for successful removal.

DMI-65 is believed to be the highest performing product on the market for manganese removal, capable of removing 2 – 3ppm through a single filter if the pH is maintained and LV is suitable. Manganese is best removed with DMI-65 as close to pH 8 as possible and at an LV of about 5 – 10m3/m2/hour, about half that of an LV used for iron removal.

The complicated thing to account for in every water matrix is the combination of iron and manganese as iron will be removed first in the upper part of the filter bed and then manganese will be removed latter in the bottom part of the filter bed. This is why some times using two filters in series allows greater linear passing of the raw water and greater polishing while halving the backwash velocity between two filter beds.

As a guide, all successful DMI-65 case studies have demonstrated, the higher the concentration of iron and manganese the slower the LV should be. If the is very low amounts of iron and particularly manganese then higher the LV can be – having a significant effect on the cost of the initial plant setup.

As a guide we recommend these conservative limits given that the water is under 5NTU TDS:

Iron

0.3ppm – 1ppm = LV 15 - 20m3/m2/hour is possible

1ppm – 5ppm = LV 10 - 15m3/m2/hour is acceptable and is a common standard.

5ppm – 10ppm = LV 10m3/m2/hour is acceptable and is a common standard.

10ppm – 15ppm = LV 7 – 9m3/m2/hour is acceptable and is a common standard

Greater than 15ppm = LV 5 – 7m3/m2/hour

All at a neutral pH of 6.8 – 7.2 if possible

It is often the case as in the harsh Australian climate to have water sources with iron concentrations upward of 50ppm. In this instance is best to use a holding tank to pre-oxidise by aeration and let the iron coagulate and settle to the bottom of the tank this will knock out 90% of the iron leaving a much more accommodating water concentration of 5ppm to be polished out by the DMI-65 at a LV of 10 – 15m³/m²/hour.

Manganese

0.5ppm – 1ppm = LV 8 – 10m³/m²/hour

1ppm – 2ppm = LV 5 – 7m³/m²/hour

Greater than 2ppm would require the same technique above by dosing the holding tank with chlorine and allowing about 10 to 15 minutes detention time to oxidise the manganese, the remaining manganese that has not oxidised will be polished out the but the DMI-65.

All at a pH of as close pH8 as possible.

Iron and Manganese

Typically iron and manganese exist together in ground water sources at low levels of under 2ppm and 1ppm respectively. In these sorts of conditions I recommend the following:

Iron 2ppm – Manganese 1ppm = LV 8 – 9m³/m²/hour as close to pH 7.5 – 8 as possible.

If the Iron concentration is higher than 2ppm and has some manganese, than slow LV down to between perhaps 7 – 8m³/m² hour and maintain pH as close to 7.5 – 8 as possible.

If the manganese concentration is higher than 1ppm and there is considerable iron say 2 – 3ppm also, than the water matrix is very dependent on a slow LV of 5 – 7m³/m²/hour and pH 8 is highly necessary.

For any water matrix that contains high iron (considered to be above 15ppm) and high manganese (considered this to be 3ppm) than the same method of pre-treatment is recommended.

Disclaimer: The information and recommendations provided are true and based on accurate case studies and professional experience. The Information and Performance guides are offered in good faith and without warranty. Quantum Filtration Medium Pty Ltd recommends DMI-65 users conduct pilot trials and demonstrate a point of proof for all commercial applications. The DMI-65 is guaranteed to be of the highest quality as described by the packaging, literature and as certified by the Water Quality Association of the USA to NSF/ANSI 61 gold standards.

Catalytic Water Filtration Media **DMI-65**
for removing Iron & Manganese



DMI-65 product has been tested and certified by the Water Quality Association according to NSF/ANSI 61 for materials safety only.



PACKAGING NOTES:

DMI-65 Advanced Oxidation Catalytic Media

- Net Bag Weight: 21kg (46.30lb)
- Net Bag Volume: 14.38L (0.5ft³)
- Bulk Density: 1.46 gl/cm³ (91lb/ft³)
- Specific Gravity: 2.69gr/cm³
- Porosity: 45.8%
- Mesh 20:40
- Pallets of 48 x DMI-65 (21kg) available = Net Weight 1008kg
- Pallets of 56 x DMI-65 (21kg) available = Net Weight 1176kg
- Whole 1 metric tonne (2,205 lbs / 24ft³) bulk bag Available.

PRODUCT OF AUSTRALIA

DMI-65 IS A REGISTERED TRADE MARK

QUANTUM FILTRATION MEDIUM PTY LTD COPYRIGHT 2014